

PDF designed for A3 colour print only with no page scaling

Contact Us

Mapping Enquiries: 0121 623 9780

General Enquiries: 0800 096 3080

Date Requested: 27/06/2024

Job Reference: 33876696

Site Location: 330447 199656

Requested by:
Mr Andrew Britton
Your Scheme/Reference:
P0560 - The Walk New Inn,
Pontypool

Scale: 1:513 (When plotted at A3)

IMPORTANT NOTICES


- This information is given as a guide only and its accuracy cannot be guaranteed. Services or recent additions to the network may not be shown.
- Cables, overhead lines & substations owned by other electricity network owners or private companies may be present and may not be shown.
- You should always verify exact locations of cables using a cable locator and by careful use of hand tools in accordance with HSE guidance note HSG47.
- When working within 10m of any overhead electric line you should follow the requirements of HSE Guidance Note GS6.
- For further advice on working near our electricity cables or lines, call our Contact Centre on 0800 096 3080.
- Advice should be sought from the National Grid Electricity Distribution Contact Centre for any work that is to take place in proximity to 66kV or 132kV underground cables and 66kV 132kV overhead lines – 0800 096 3080

Link Box ●	Overhead Line —○— PL —○— Service —○— LV —○— HV (11kV) —○— HV (33kV) —○— HV (66kV) —○— HV (132kV)	Underground Cable - - - - - PL - - - - - Service - - - - - LV - - - - - HV (11kV) - - - - - HV (33kV) - - - - - HV (66kV) - - - - - HV (132kV)	National Grid Telecoms —S—S— Private Cables —S—S— PME Earth —E— Underground Earth —E—	Pilot Cables —P—P— Pole Mounted Transformer ○ Ground Mounted Transformer □
----------------------	--	--	--	--

Report damage immediately KEEP EVERYONE AWAY FROM THE AREA
0800 6783 105

nationalgrid **Electricity Distribution**

Email: NGED.MapResponse@NationalGrid.co.uk

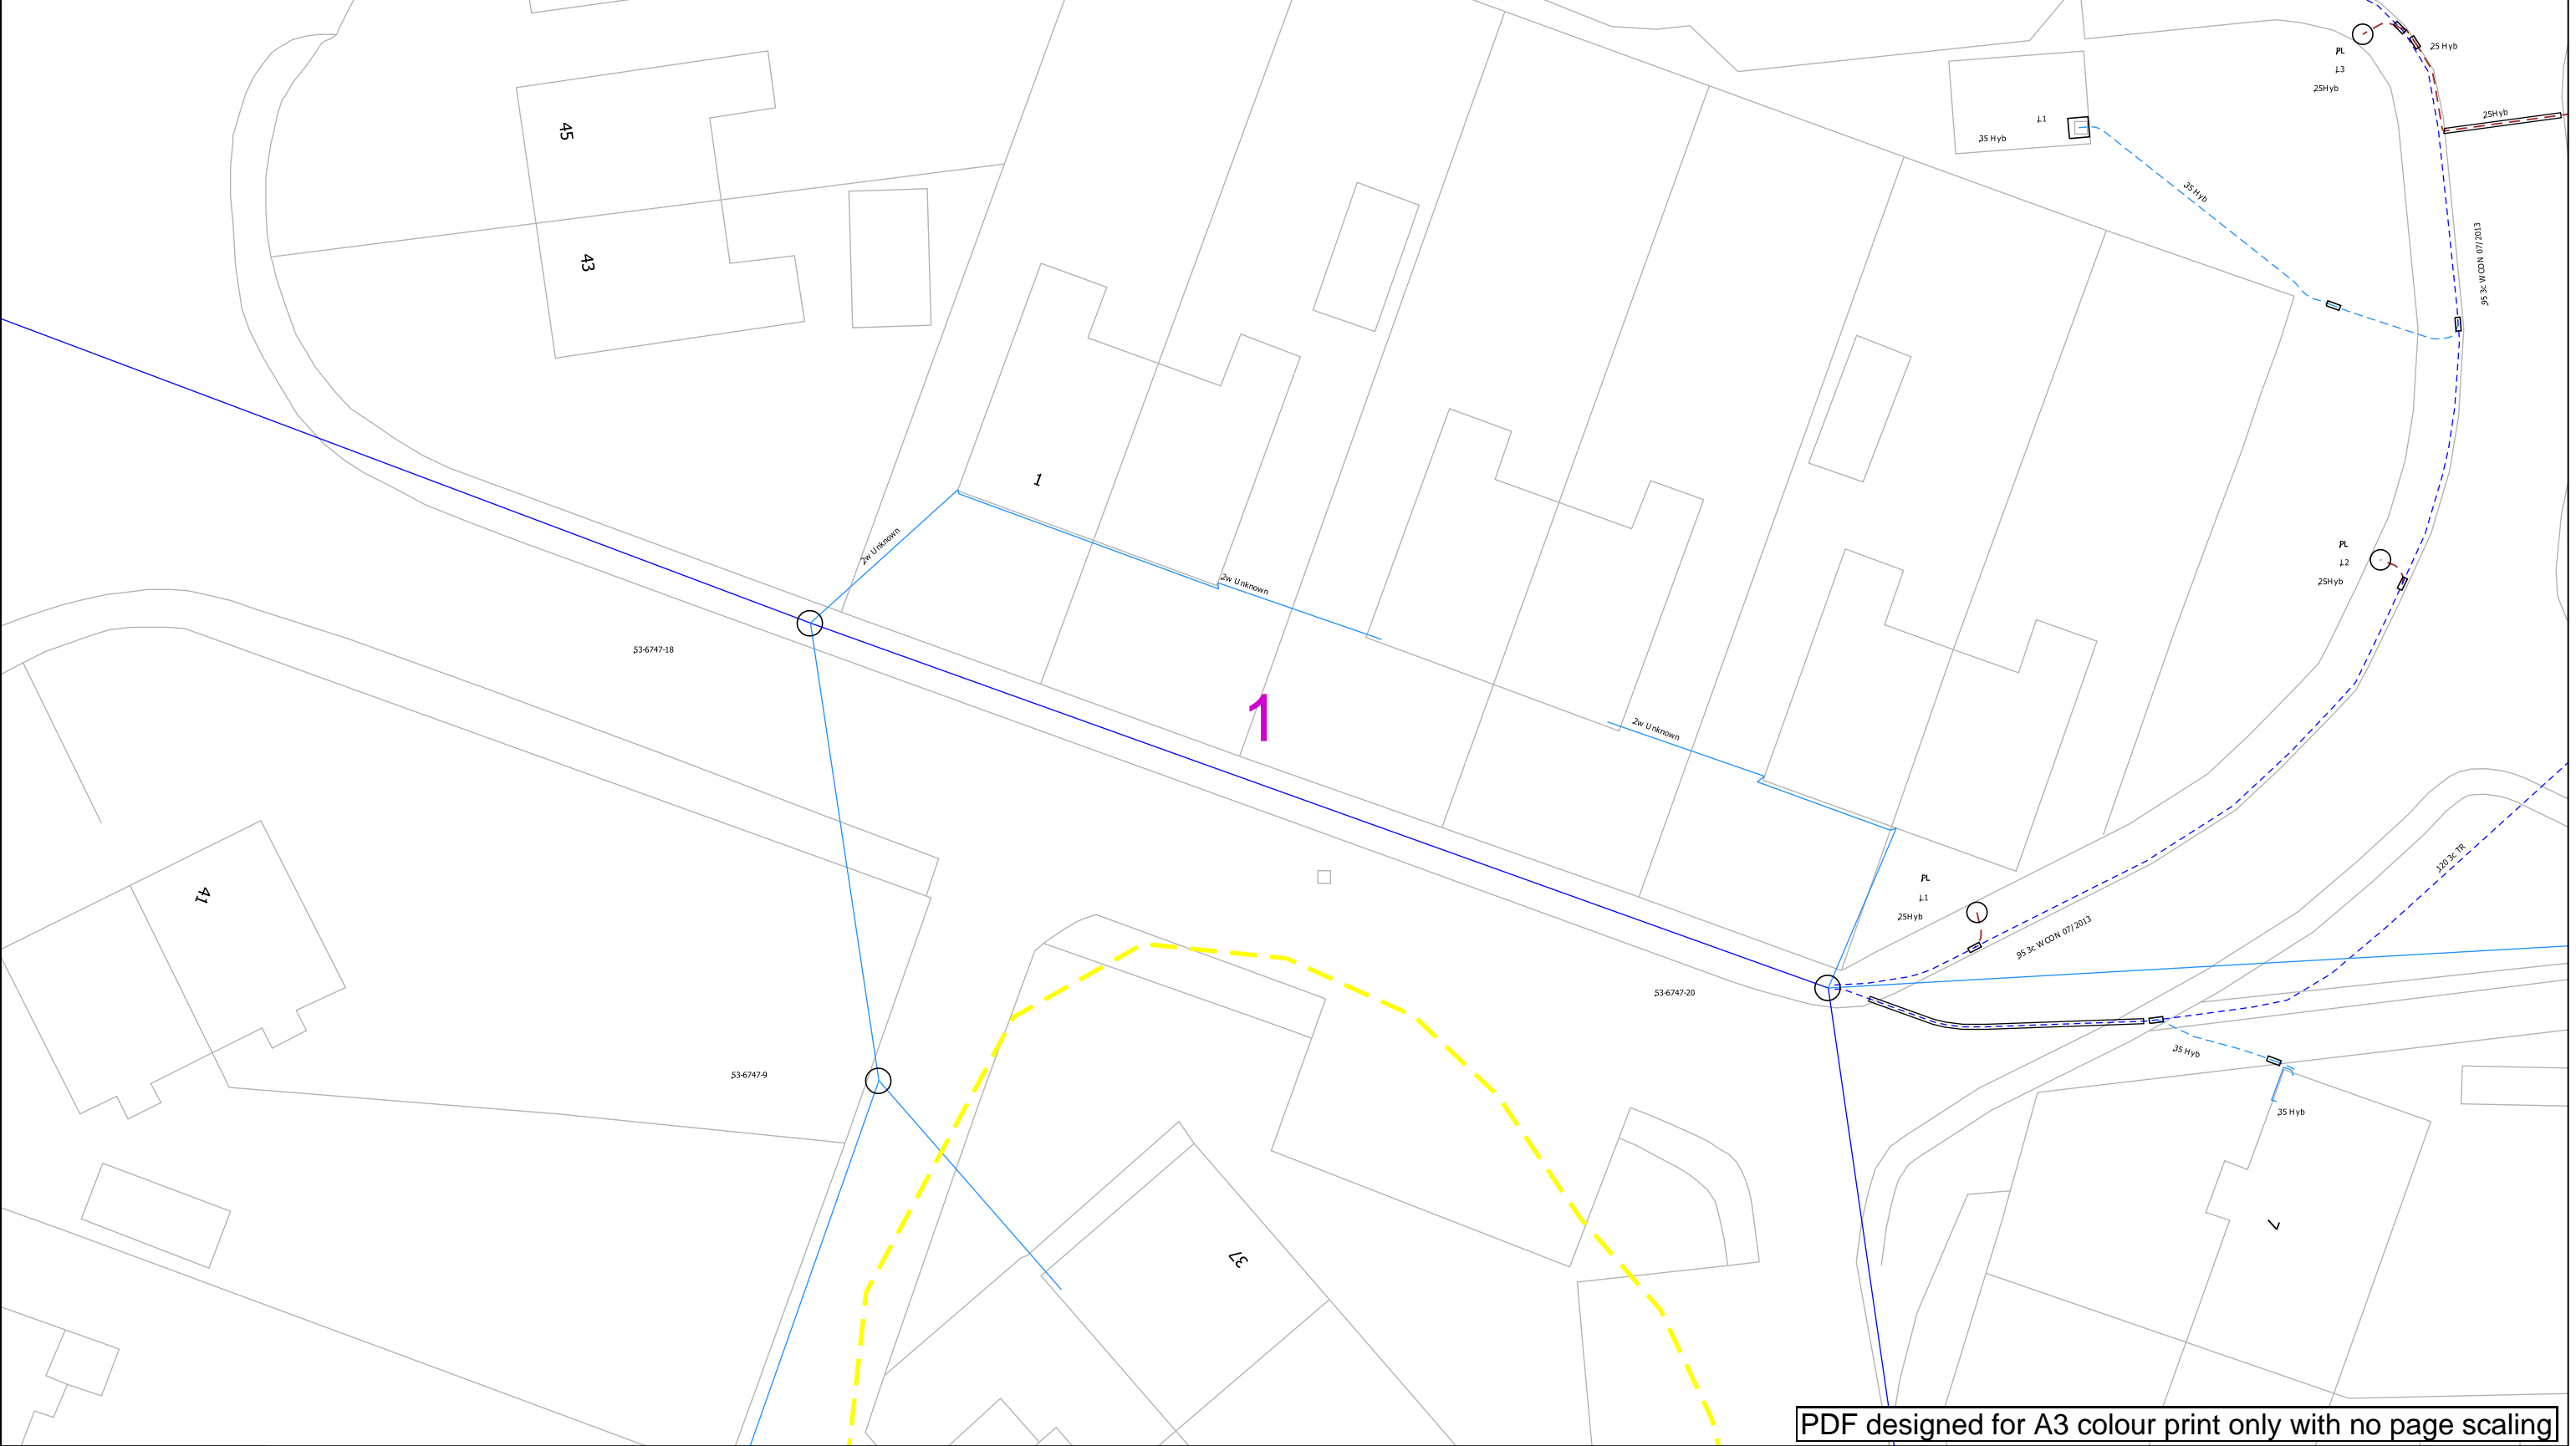

PDF designed for A3 colour print only with no page scaling

Contact Us

Mapping Enquiries: 0121 623 9780

General Enquiries: 0800 096 3080

Date Requested: 27/06/2024

Job Reference: 33876696

Site Location: 330447 199656

Requested by:
Mr Andrew Britton

Your Scheme/Reference: P0560 - The Walk New Inn, Pontypool

Scale: 1:250 (When plotted at A3)

IMPORTANT NOTICES

- This information is given as a guide only and its accuracy cannot be guaranteed. Services or recent additions to the network may not be shown.
- Cables, overhead lines & substations owned by other electricity network owners or private companies may be present and may not be shown.
- You should always verify exact locations of cables using a cable locator and by careful use of hand tools in accordance with HSE guidance note HSG47.
- When working within 10m of any overhead electric line you should follow the requirements of HSE Guidance Note GS6.
- For further advice on working near our electricity cables or lines, call our Contact Centre on 0800 096 3080.
- Advice should be sought from the National Grid Electricity Distribution Contact Centre for any work that is to take place in proximity to 66kV or 132kV underground cables and 66kV 132kV overhead lines – 0800 096 3080

0 25m

Link Box

●

Site Location

Line/Area

— — — — —

Overhead Line

- PL
- Service
- LV
- HV (11kV)
- HV (33kV)
- HV (66kV)
- HV (132kV)

Underground Cable

- — — — —
- — — — —
- — — — —
- — — — —
- — — — —
- — — — —

National Grid Telecoms

— S — S —

Private Cables

— — — — —

PME Earth

— E —

Underground Earth

— — — — —

Pilot Cables

— P — P —

Pole Mounted Transformer

○

Ground Mounted Transformer

□


Report damage immediately KEEP EVERYONE AWAY FROM THE AREA

0800 6783 105

nationalgrid

Electricity Distribution

Email: NGED.MapResponse@NationalGrid.co.uk

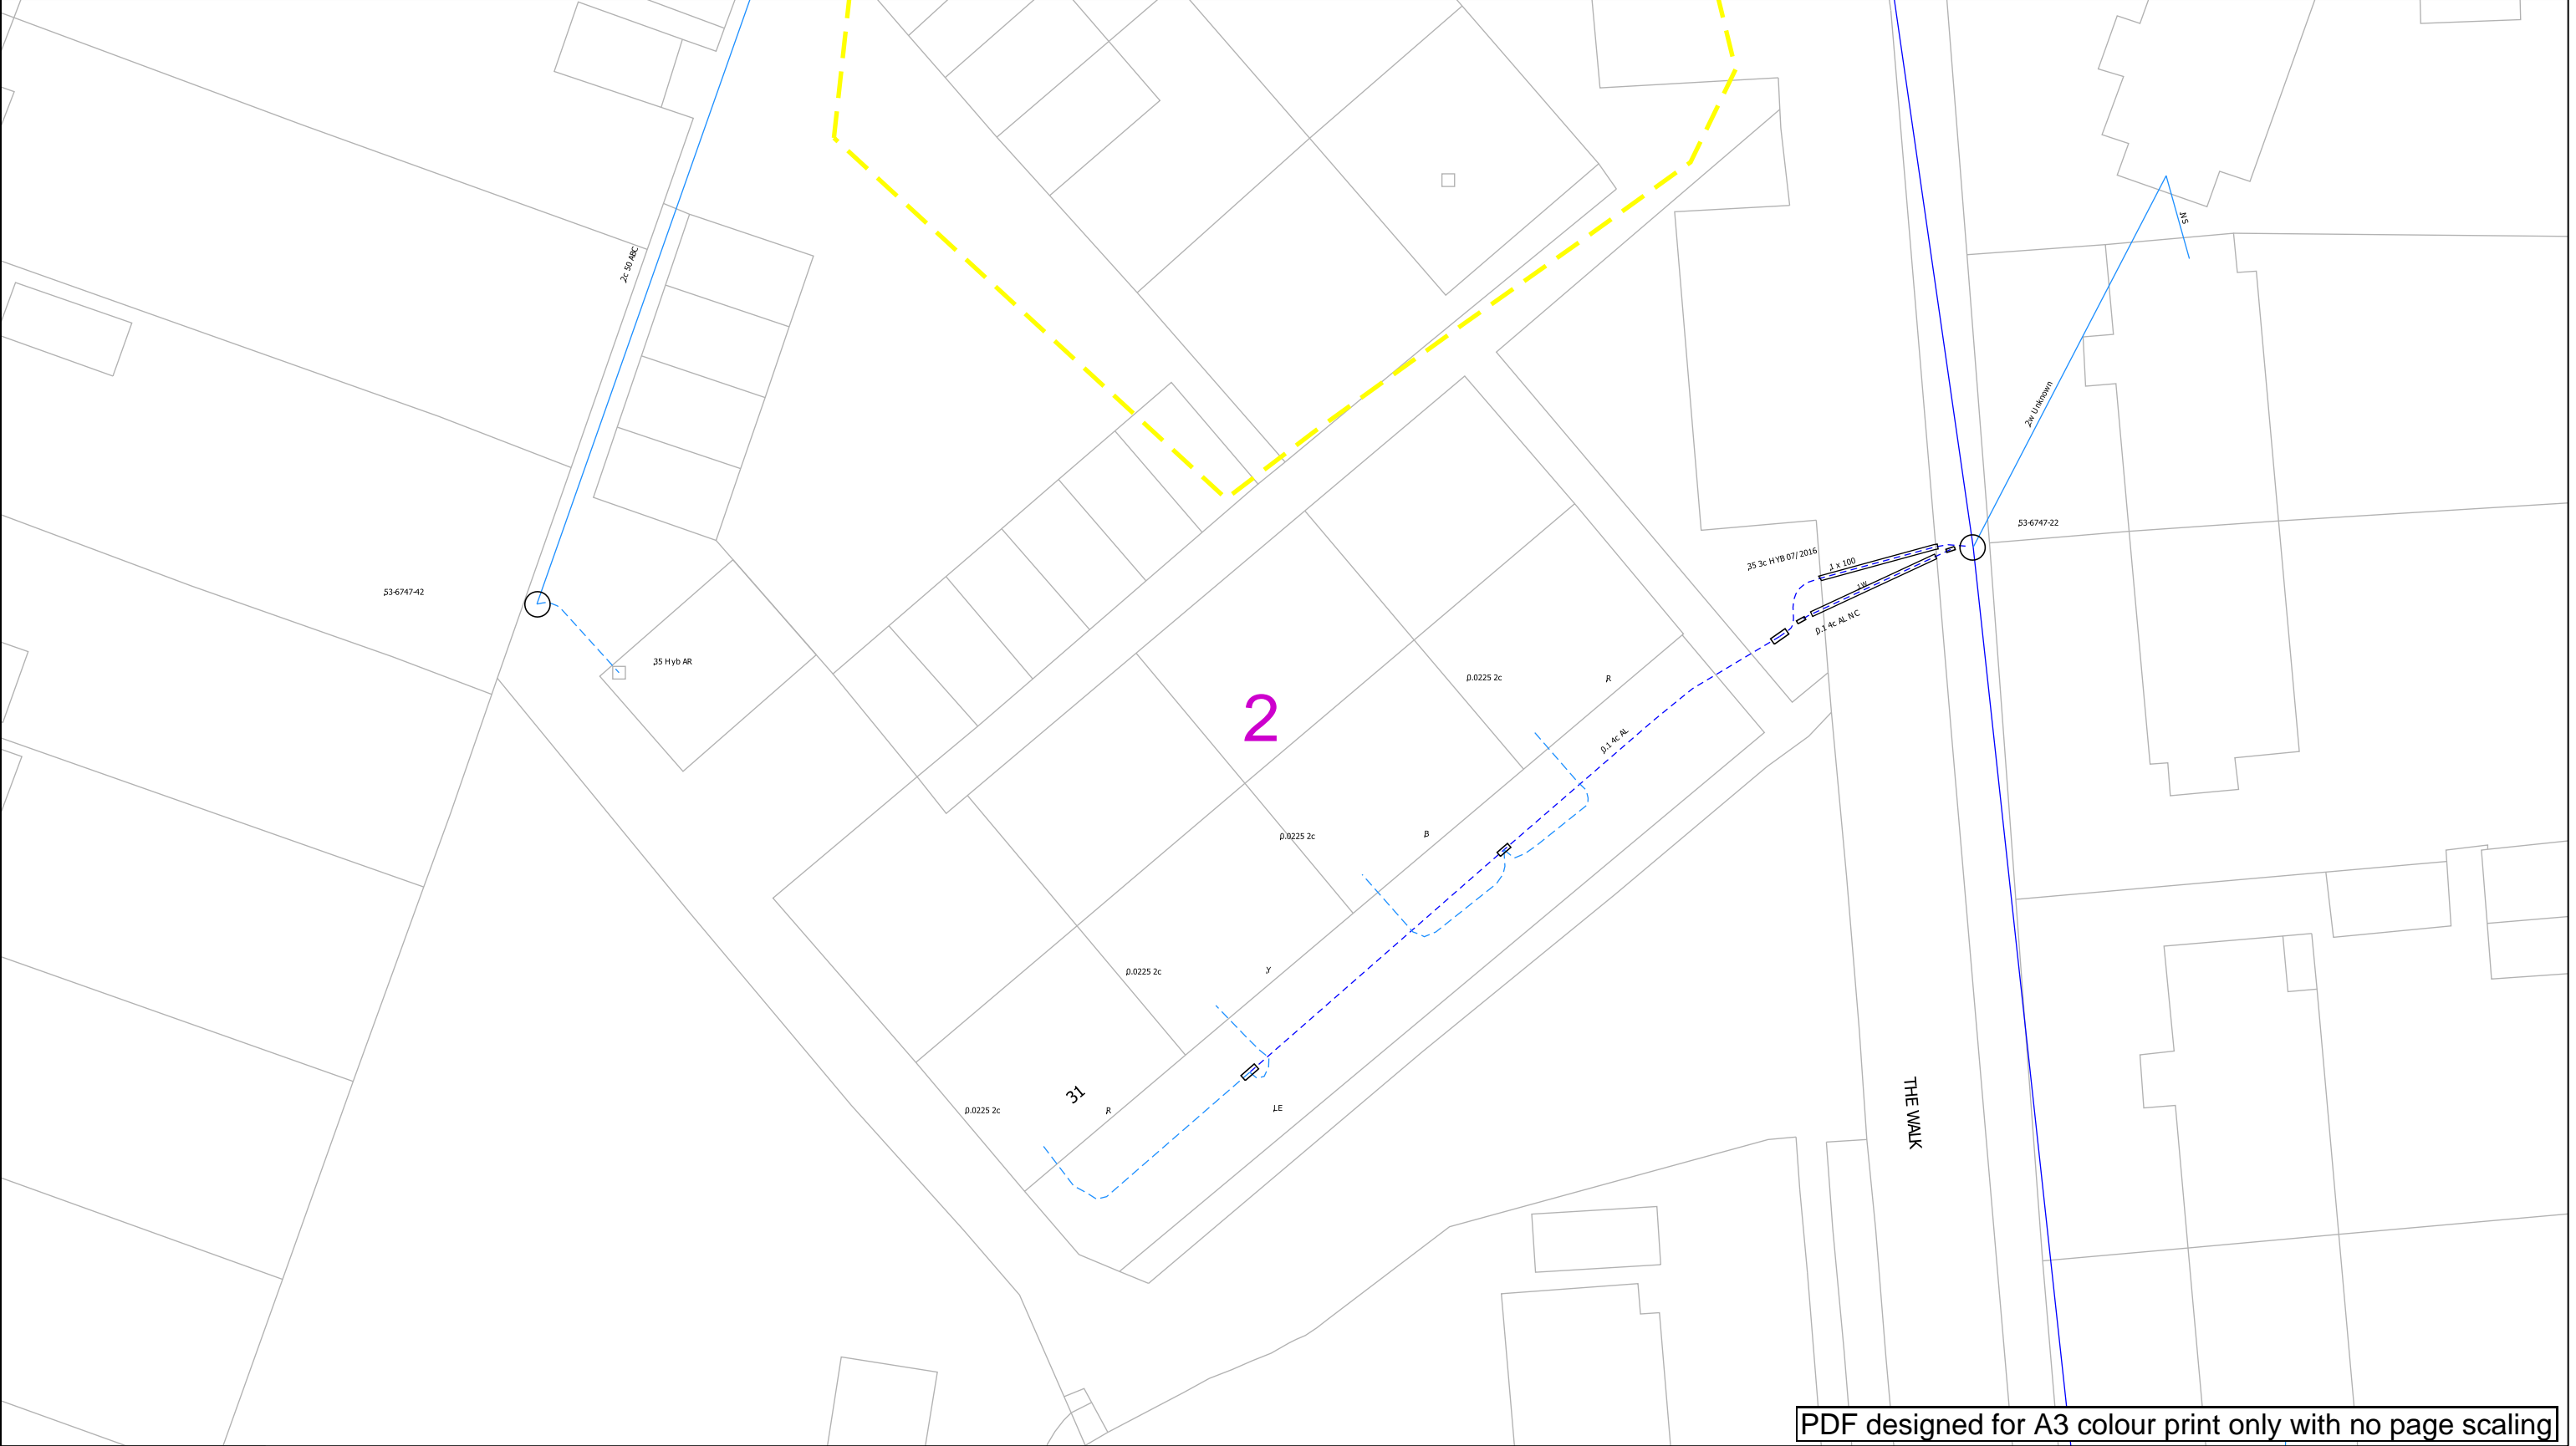

PDF designed for A3 colour print only with no page scaling

Contact Us

Mapping Enquiries: 0121 623 9780

General Enquiries: 0800 096 3080

Date Requested: 27/06/2024

Job Reference: 33876696

Site Location: 330447 199656

Requested by:
Mr Andrew Britton

Your Scheme/Reference: P0560 - The Walk New Inn, Pontypool

Scale: 1:250 (When plotted at A3)

IMPORTANT NOTICES

- This information is given as a guide only and its accuracy cannot be guaranteed. Services or recent additions to the network may not be shown.
- Cables, overhead lines & substations owned by other electricity network owners or private companies may be present and may not be shown.
- You should always verify exact locations of cables using a cable locator and by careful use of hand tools in accordance with HSE guidance note HSG47.
- When working within 10m of any overhead electric line you should follow the requirements of HSE Guidance Note GS6.
- For further advice on working near our electricity cables or lines, call our Contact Centre on 0800 096 3080.
- Advice should be sought from the National Grid Electricity Distribution Contact Centre for any work that is to take place in proximity to 66kV or 132kV underground cables and 66kV 132kV overhead lines – 0800 096 3080

0

25m

Link Box

●

Site Location

Line/Area

—|—|—|

Overhead Line

- PL
- Service
- LV
- HV (11kV)
- HV (33kV)
- HV (66kV)
- HV (132kV)

Underground Cable

- PL
- Service
- LV
- HV (11kV)
- HV (33kV)
- HV (66kV)
- HV (132kV)

National Grid Telecoms

S S

Private Cables

|||||

PME Earth

—E—|

Underground Earth

Pilot Cables

P P

Pole Mounted Transformer

○

Ground Mounted Transformer

□

Report damage immediately KEEP EVERYONE AWAY FROM THE AREA

0800 6783 105

nationalgrid

Electricity Distribution

Email: NGED.MapResponse@NationalGrid.co.uk

Crown Copyright © All Rights Reserved. Ordnance Survey Licence numbers: 100022432. NGED Copyright: This copy has been made by or with the authority of National Grid Electricity Distribution (NGED) pursuant to Section 47 of the Copyright Designs and Patents Act 1988 unless that Act provides a relevant exception to copyright the copy must not be copied without the prior permission of the copyright owner.